


100 KL SUMP

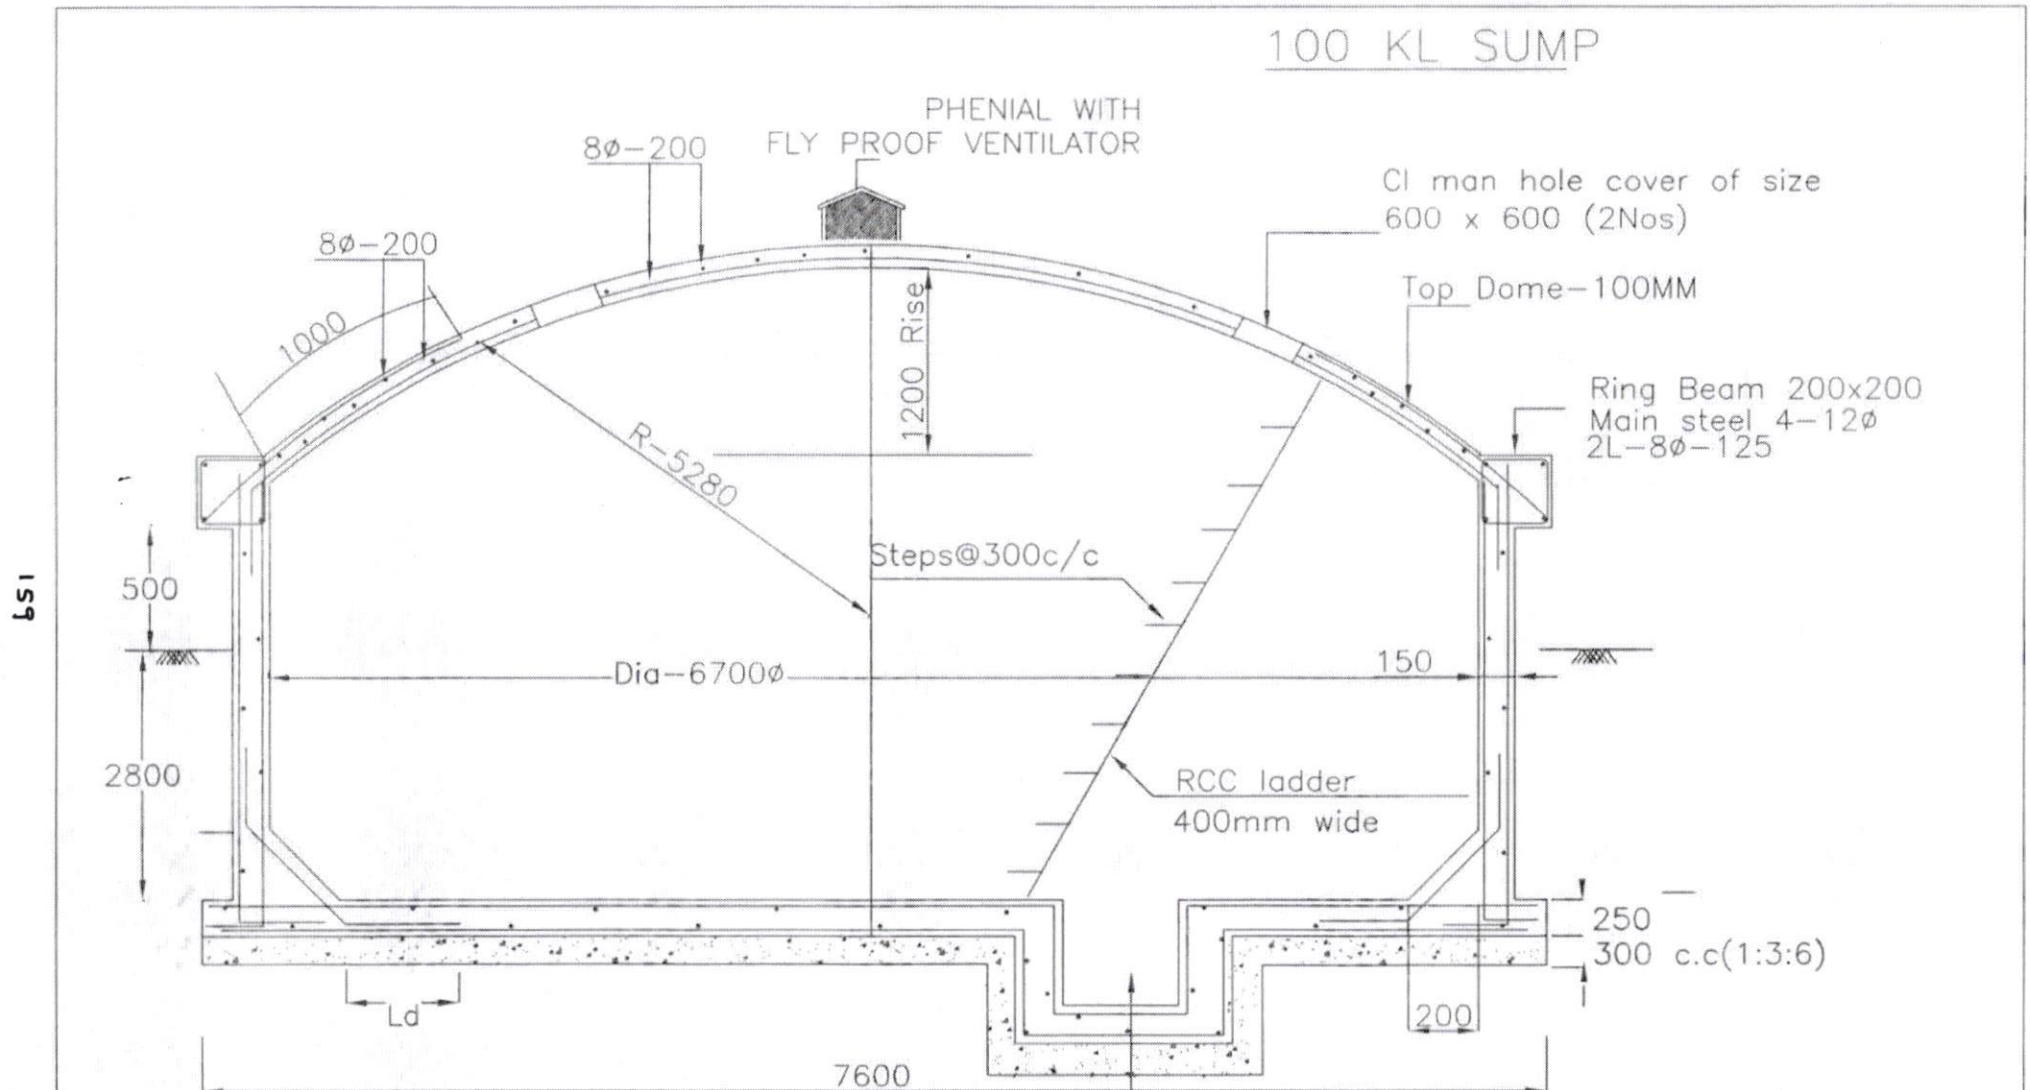

All dimensions are in 'mm'
Concrete mix V.R.C.C M30
Steel Fe-415
Reinforcement Details shall be as per IS - SP34

PGR
Asst Executive Engineer


PJM
25.01.19
Dy.Executive Engineer

//Approved//
[Signature]
Chief Engineer-II
RWS&S,Gollapudi
Vijayawada

SCHEME:
DWG.NO.1

100 KL SUMP

100

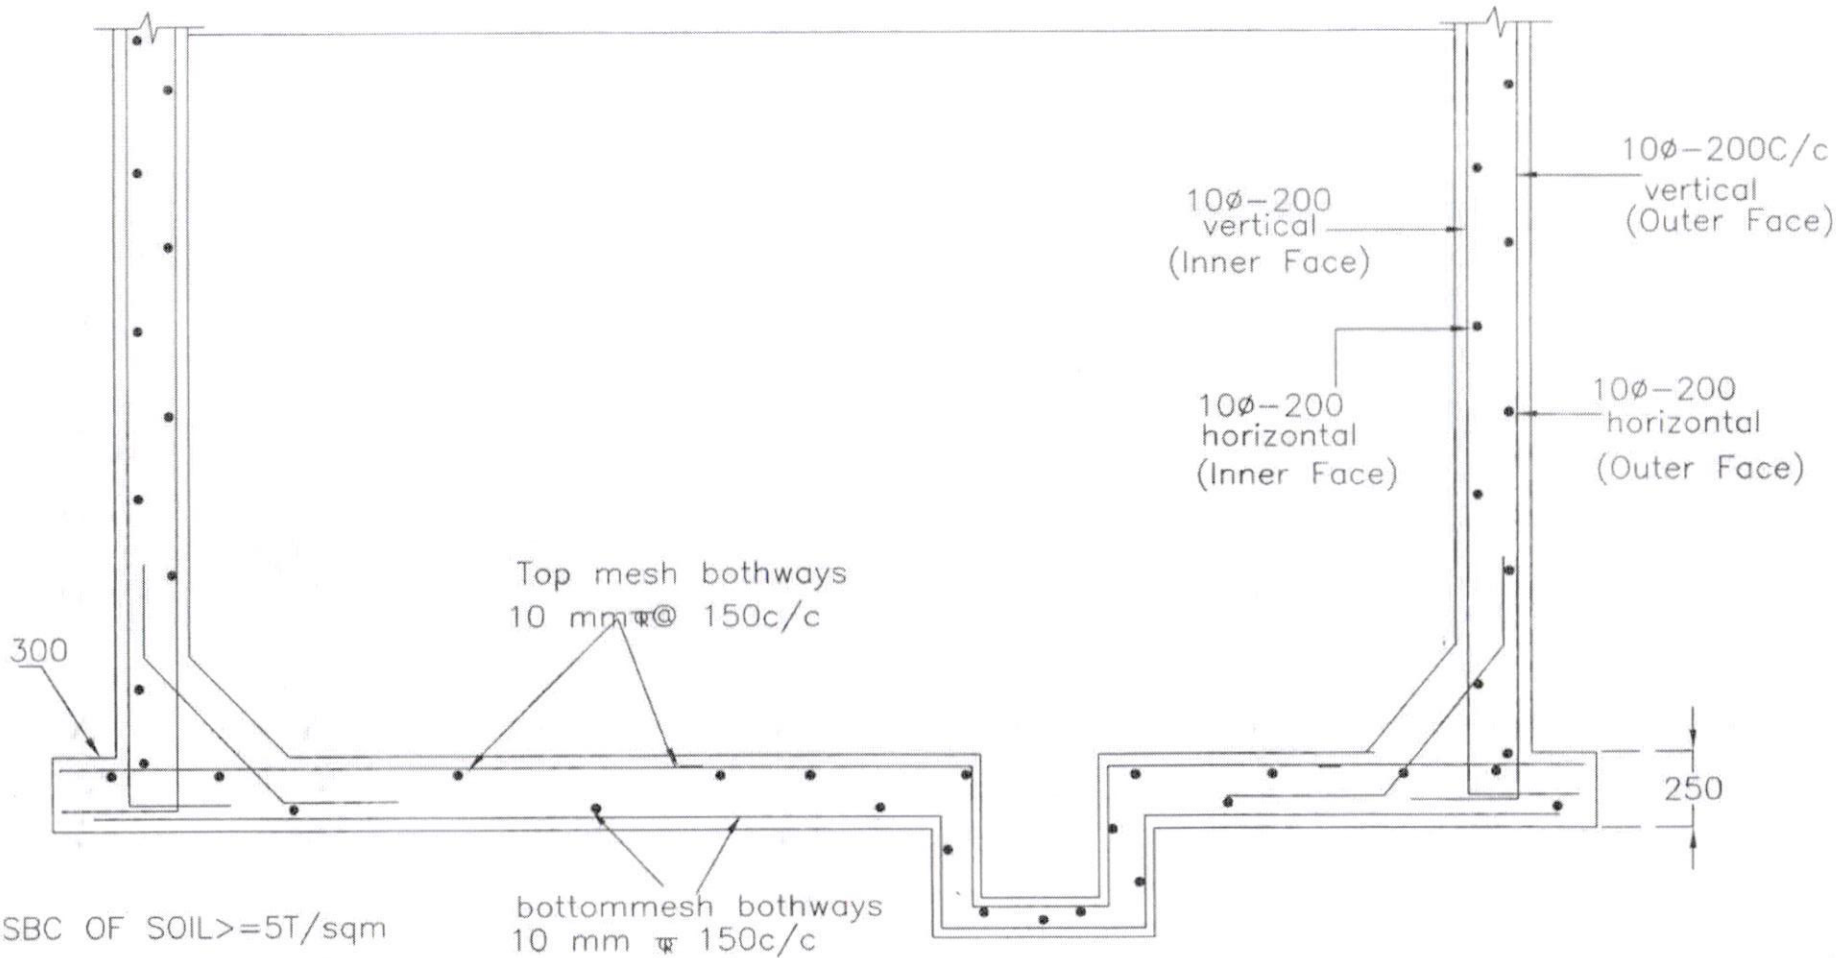

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $<$ 1.75m below GL

Rok
Asst Executive Engineer


TJM
28.01.19
Dy.Executive Engineer

Approved//
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:
DWG.NO.2

100 KL SUMP

171

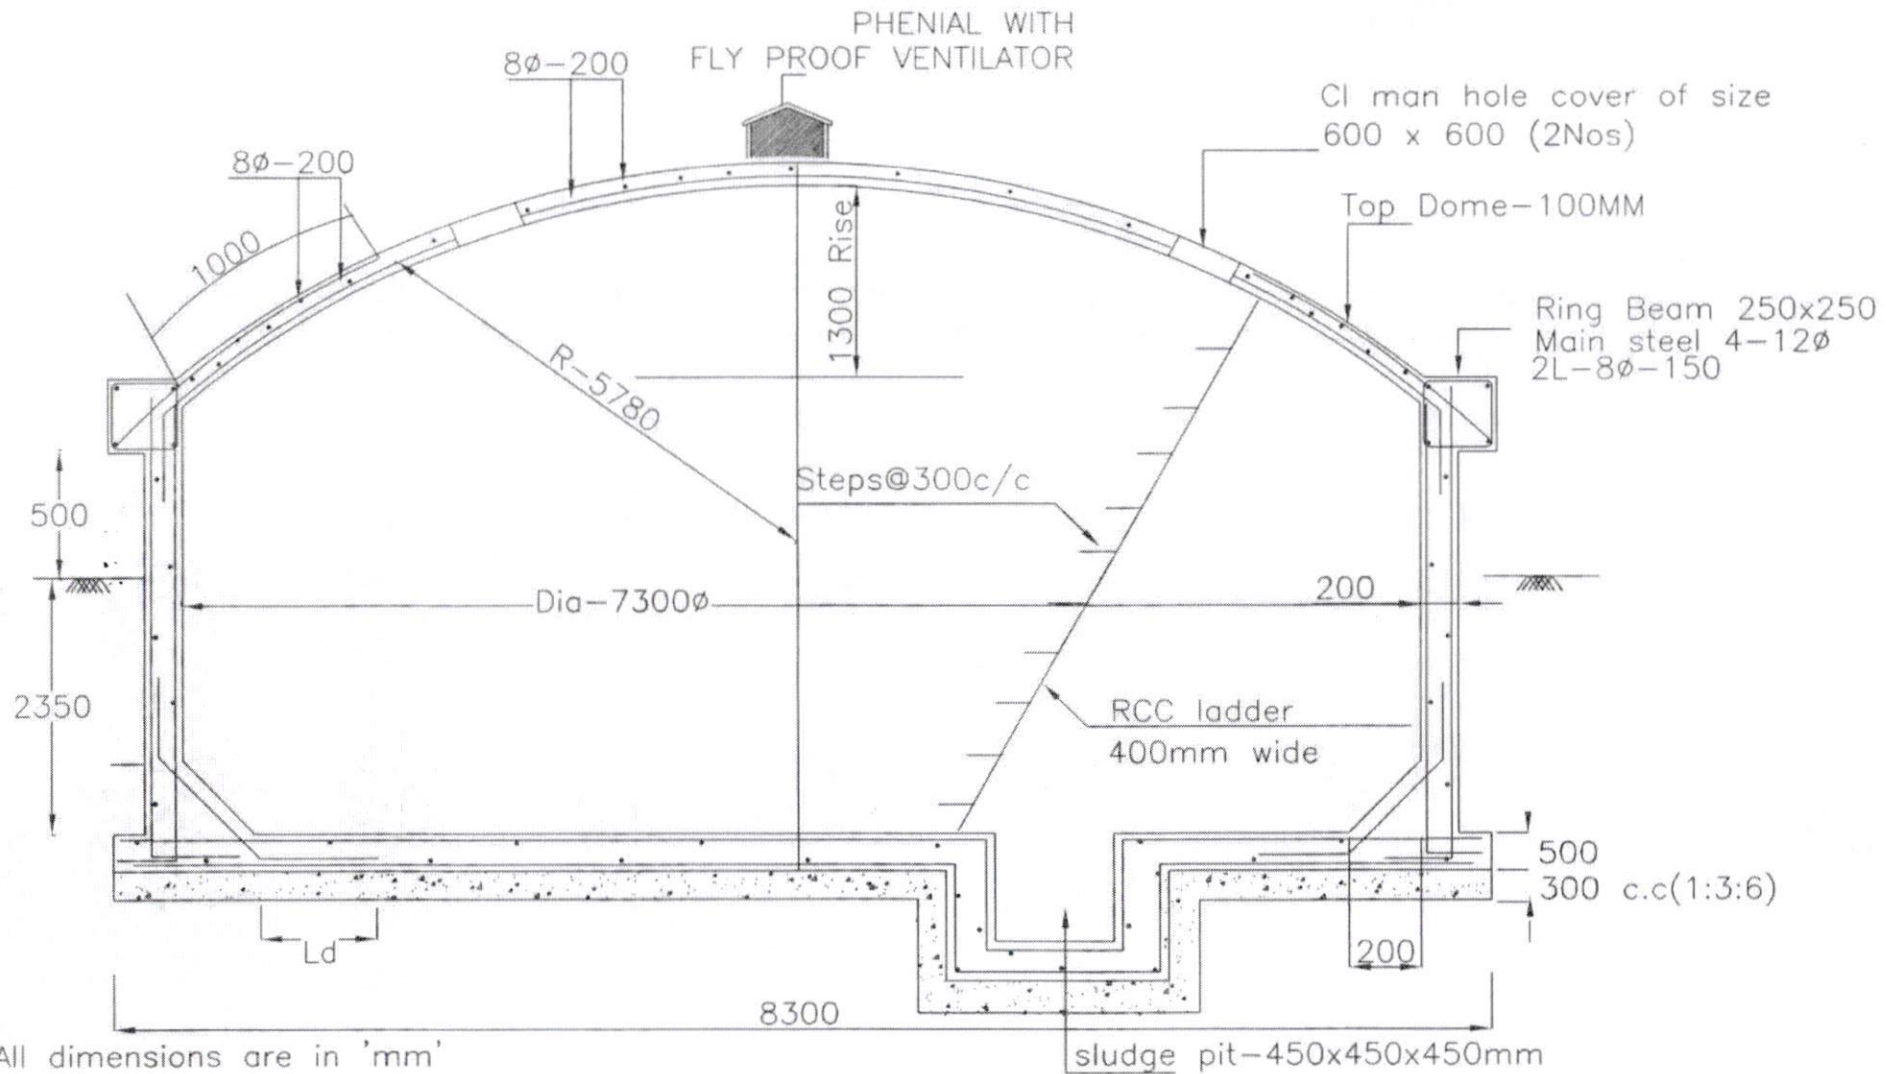

All dimensions are in 'mm'
Concrete mix V.R.C.C M30
Steel Fe-415
Reinforcement Details shall be as per IS - SP34

BR
Asst Executive Engineer

25.01.19
Dy. Executive Engineer

//Approved//
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.


Sump is designed for uplift

SCHEME:

DWG.NO.1

100 KL SUMP

162

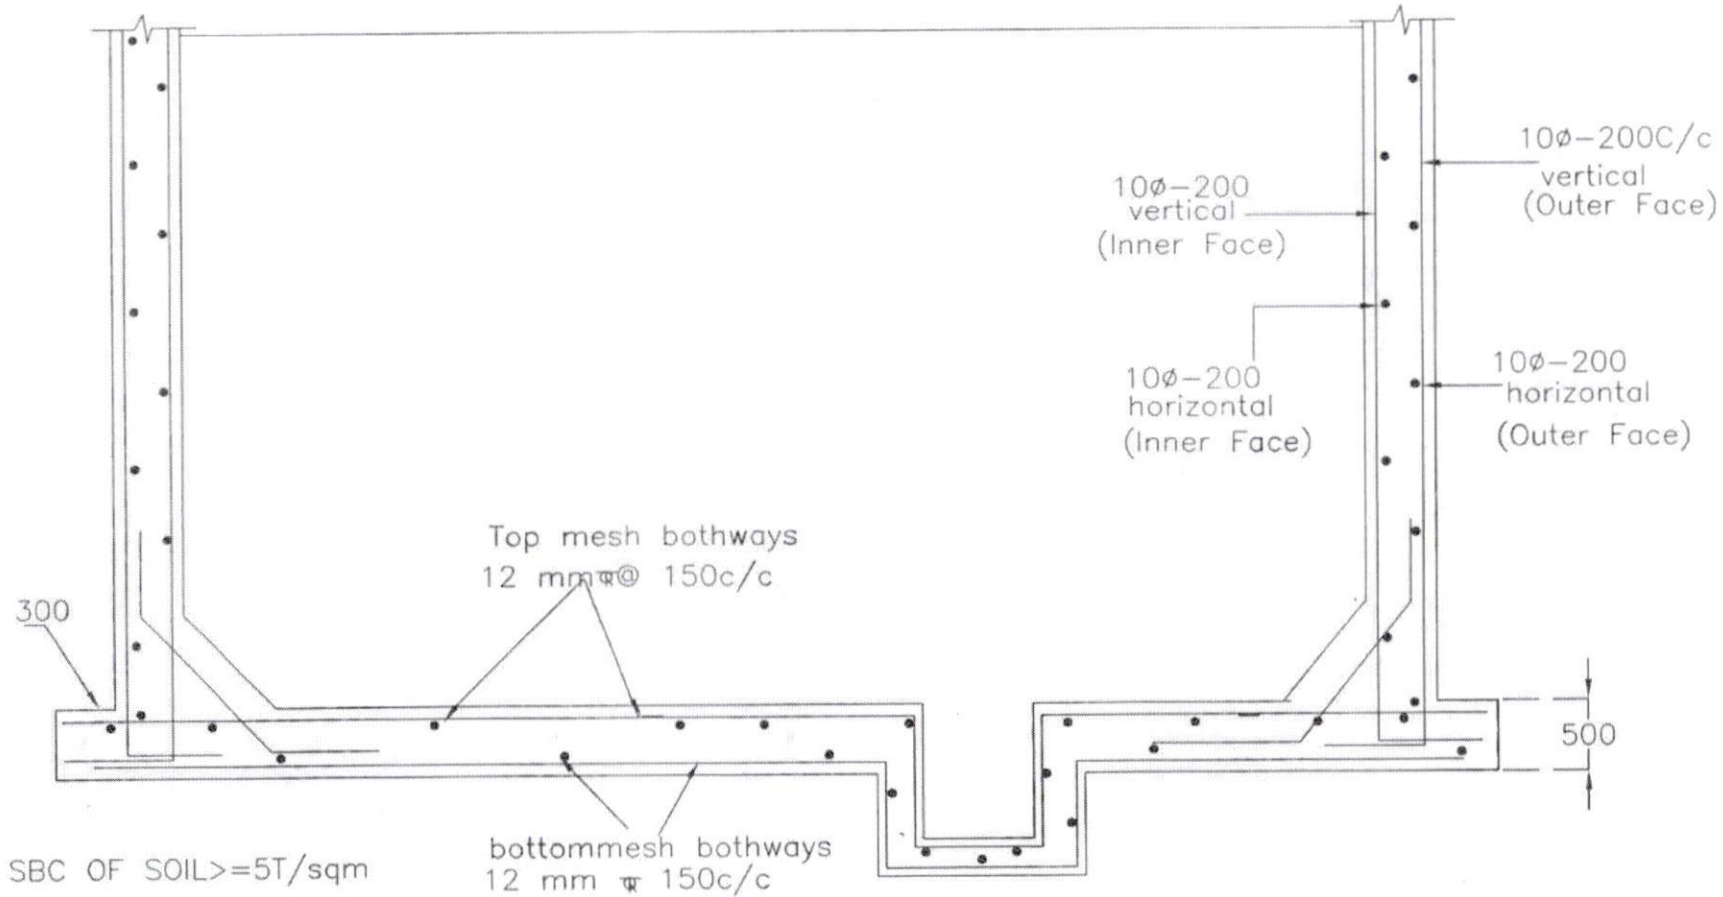

SBC OF SOIL \geq 5T/sqm

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $<$ 1.0m below GL

PQR
Asst Executive Engineer

RJM
25.01.19
Dy. Executive Engineer

[Signature]
Approved/
Chief Engineer-II
RWS&S, Gallapudi
Vijayawada.

SCHEME:
DWG.NO.2