


325 KL SUMP

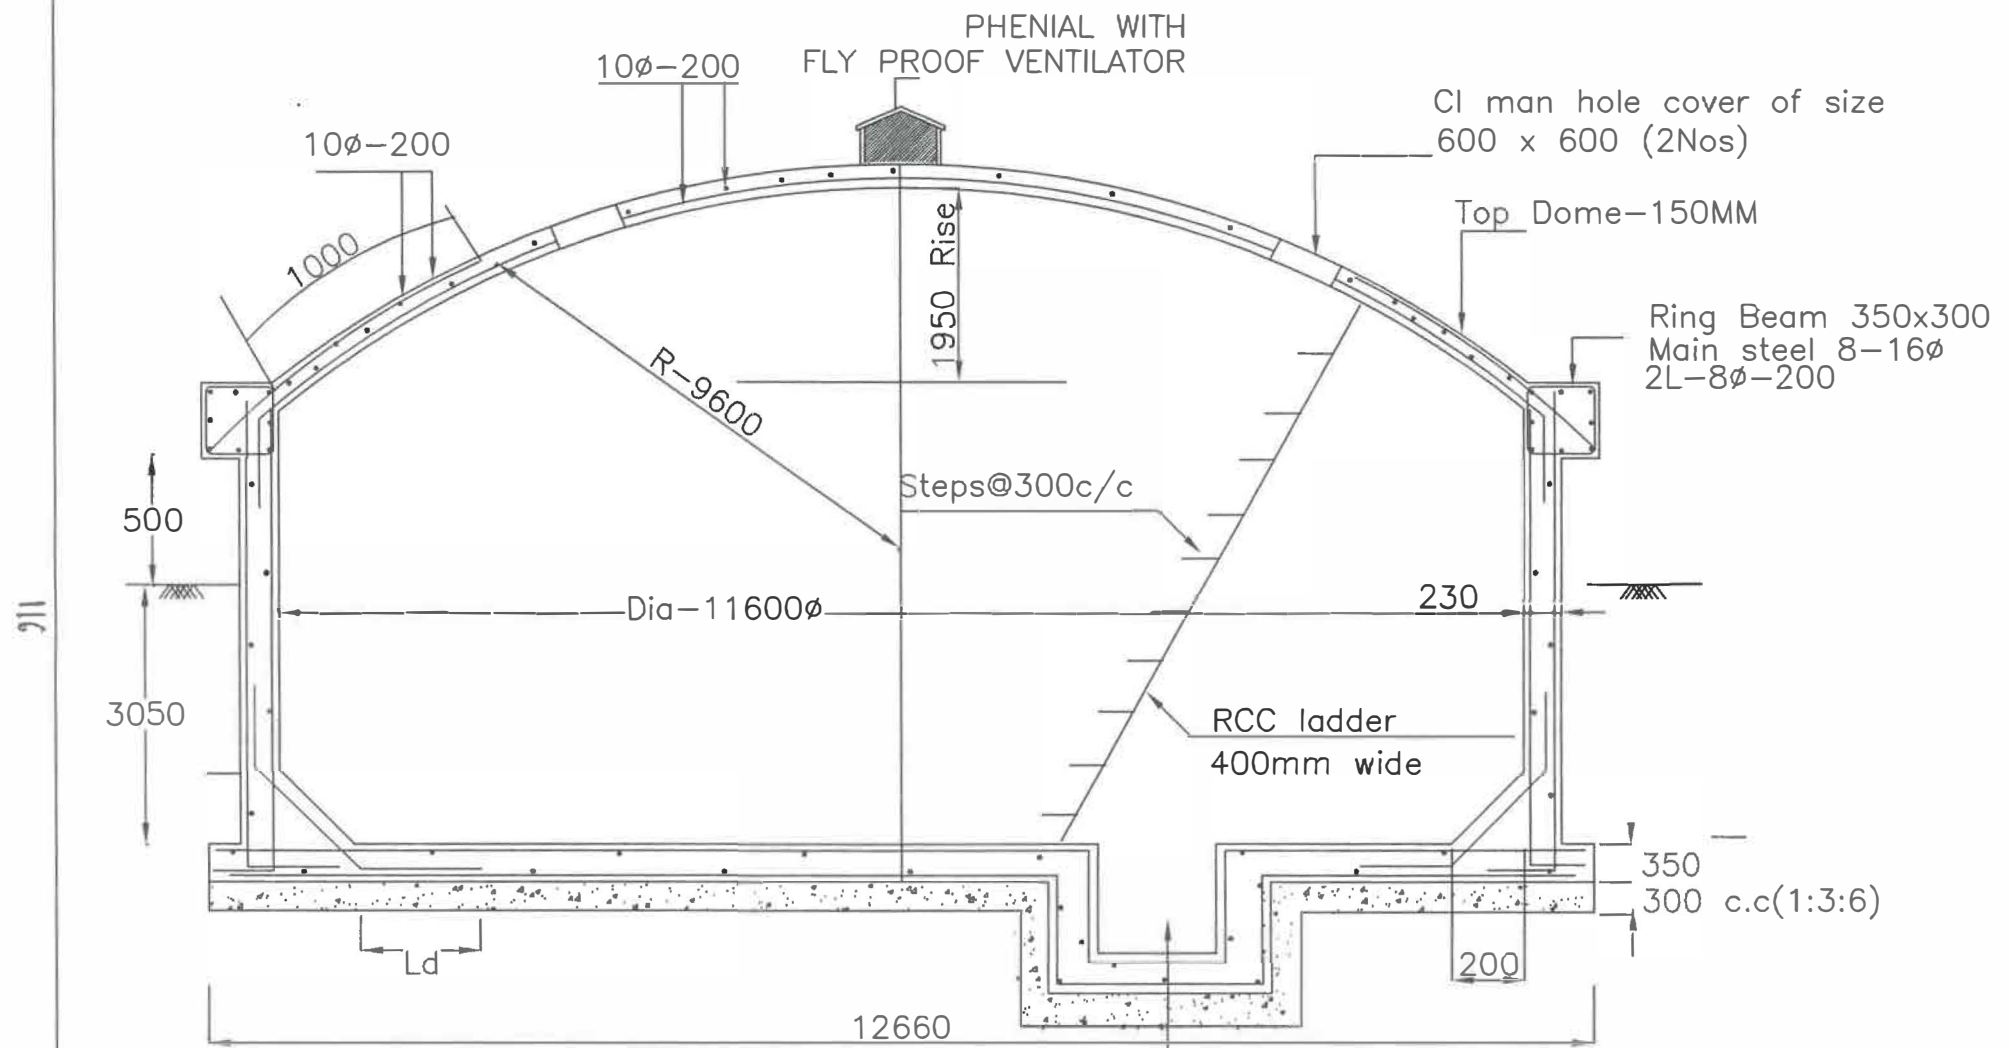

All dimensions are in 'mm'
 Concrete mix V.R.C.C M30
 Steel Fe-415
 Reinforcement Details shall be as per IS - SP34

H.P. Saileja
 Asst Executive Engineer


POR
 Dy.Executive Engineer

Y.S.
 Executive Engineer

//Approved//
[Signature]
 Chief Engineer
 RWS&S.Gollapudi
 Vijayawada.

SCHEME:
DWG.NO.1

325 KL SUMP

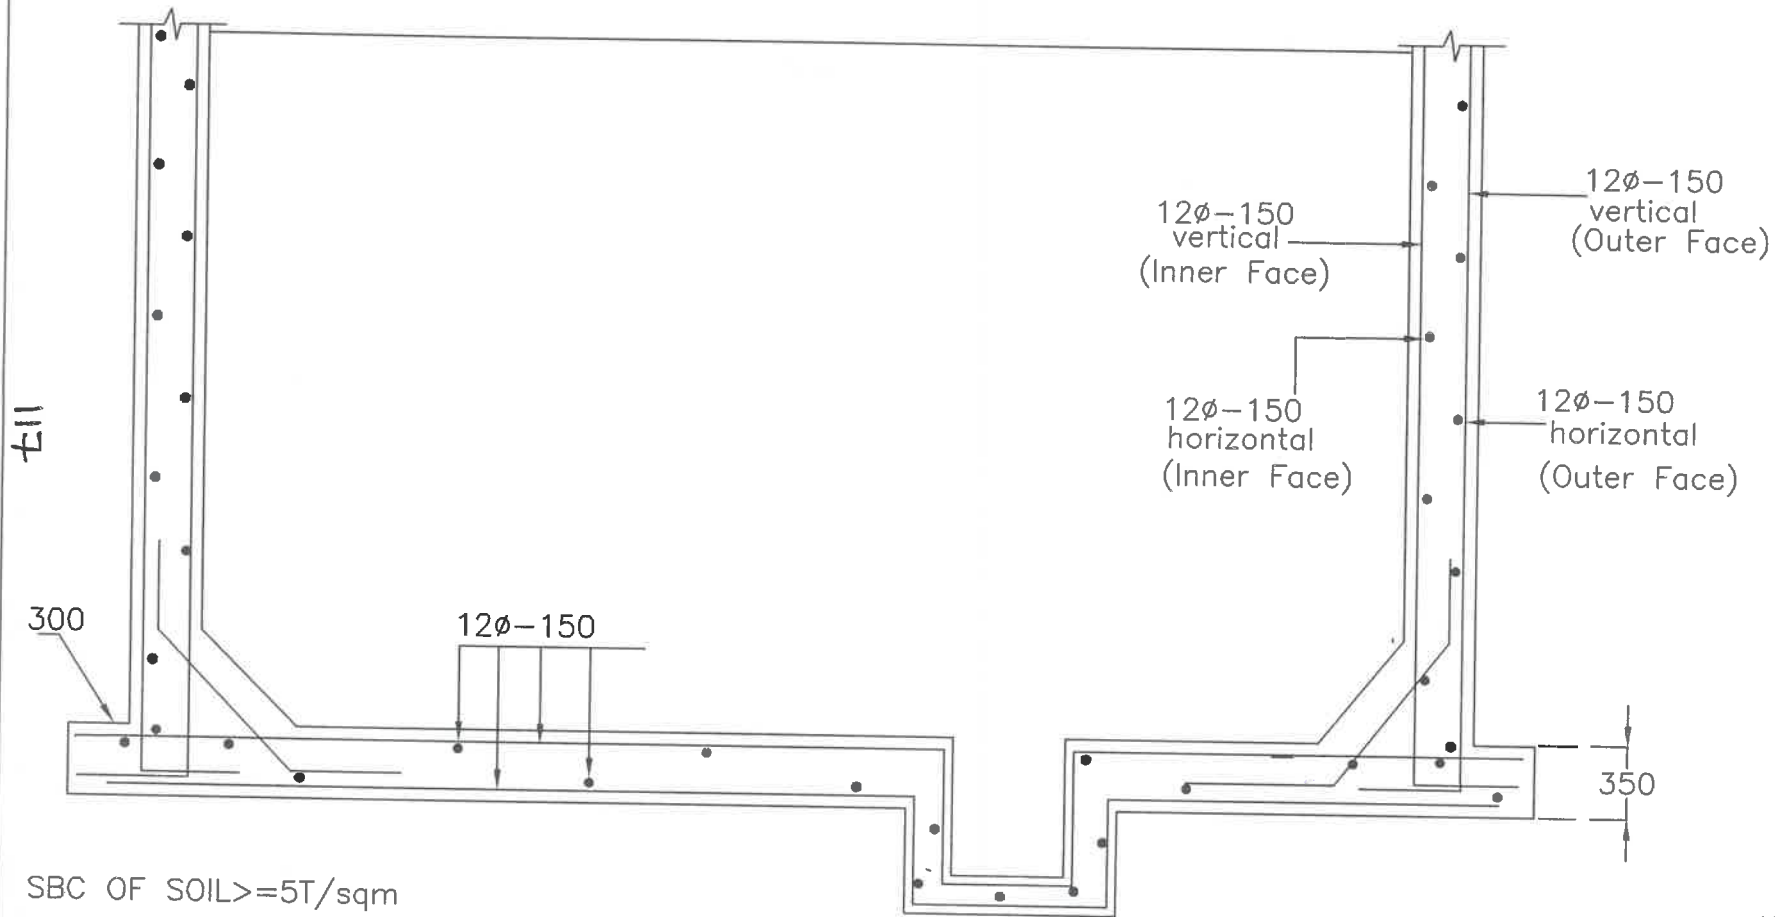

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.75m$ below GL

H. P. Sastry
Asst. Executive Engineer

P. K. R.
Dy. Executive Engineer


Y. S.
Executive Engineer

// Approved //
R. S. S.
Chief Engineer
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2

325 KL SUMP

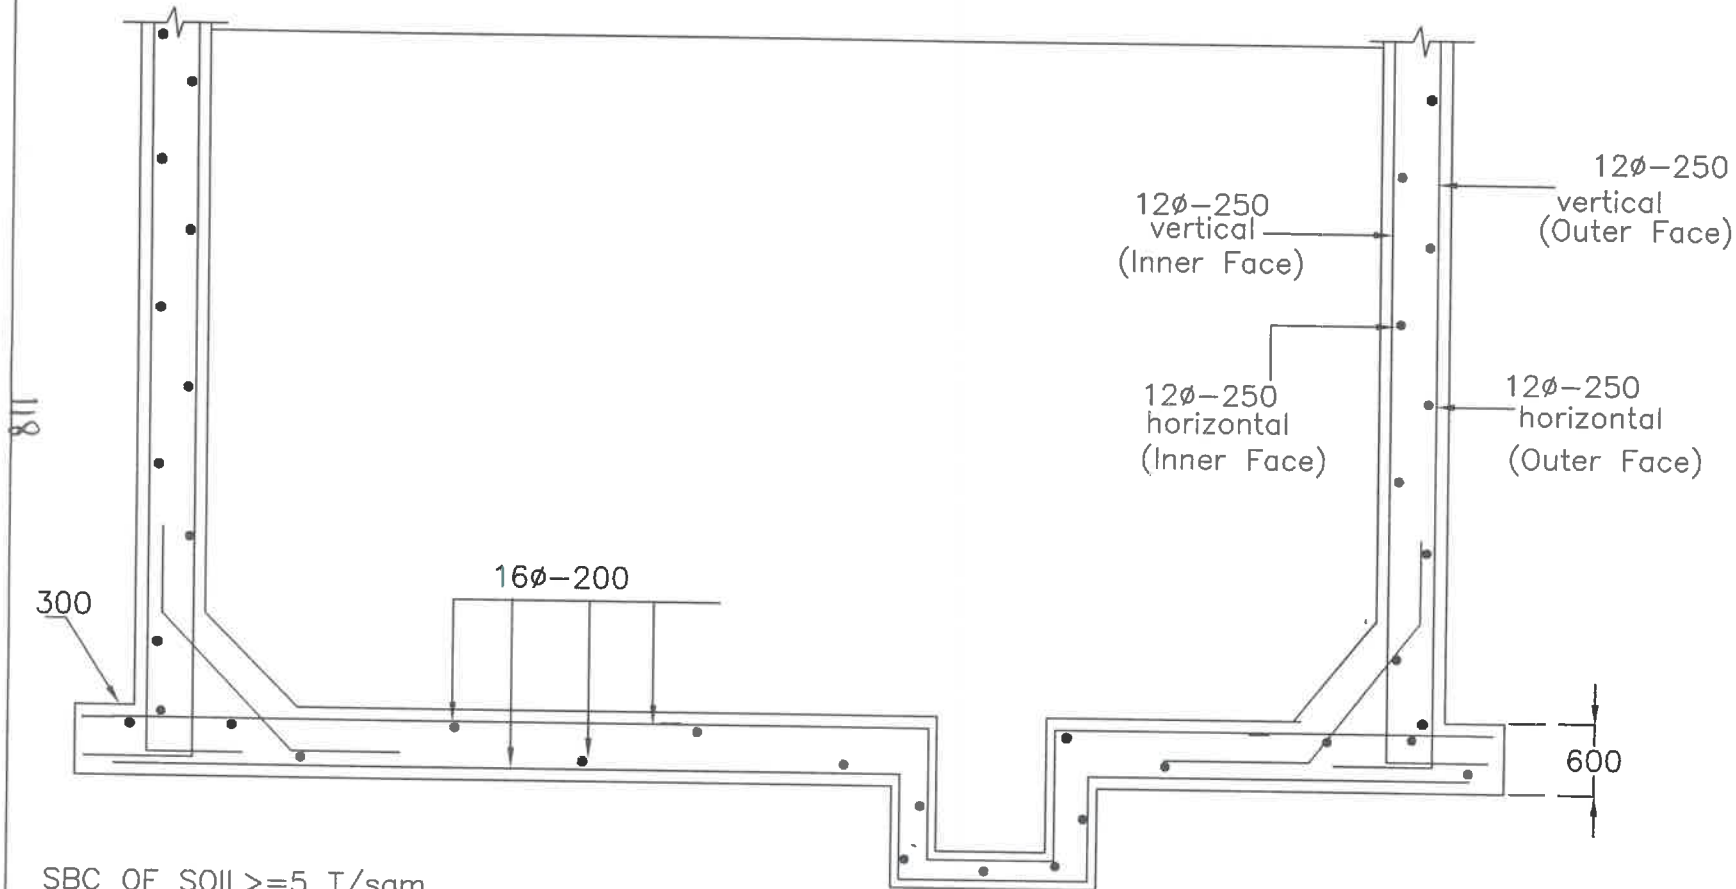

SBC OF SOIL ≥ 5 T/sqm
Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table < 1.0 m below GL


H.P. Sastry Asst Executive Engineer
PUR Dy. Executive Engineer
Y.S. Executive Engineer

//Approved//
R. S. S.
Chief Engineer-I
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2

325 KL SUMP

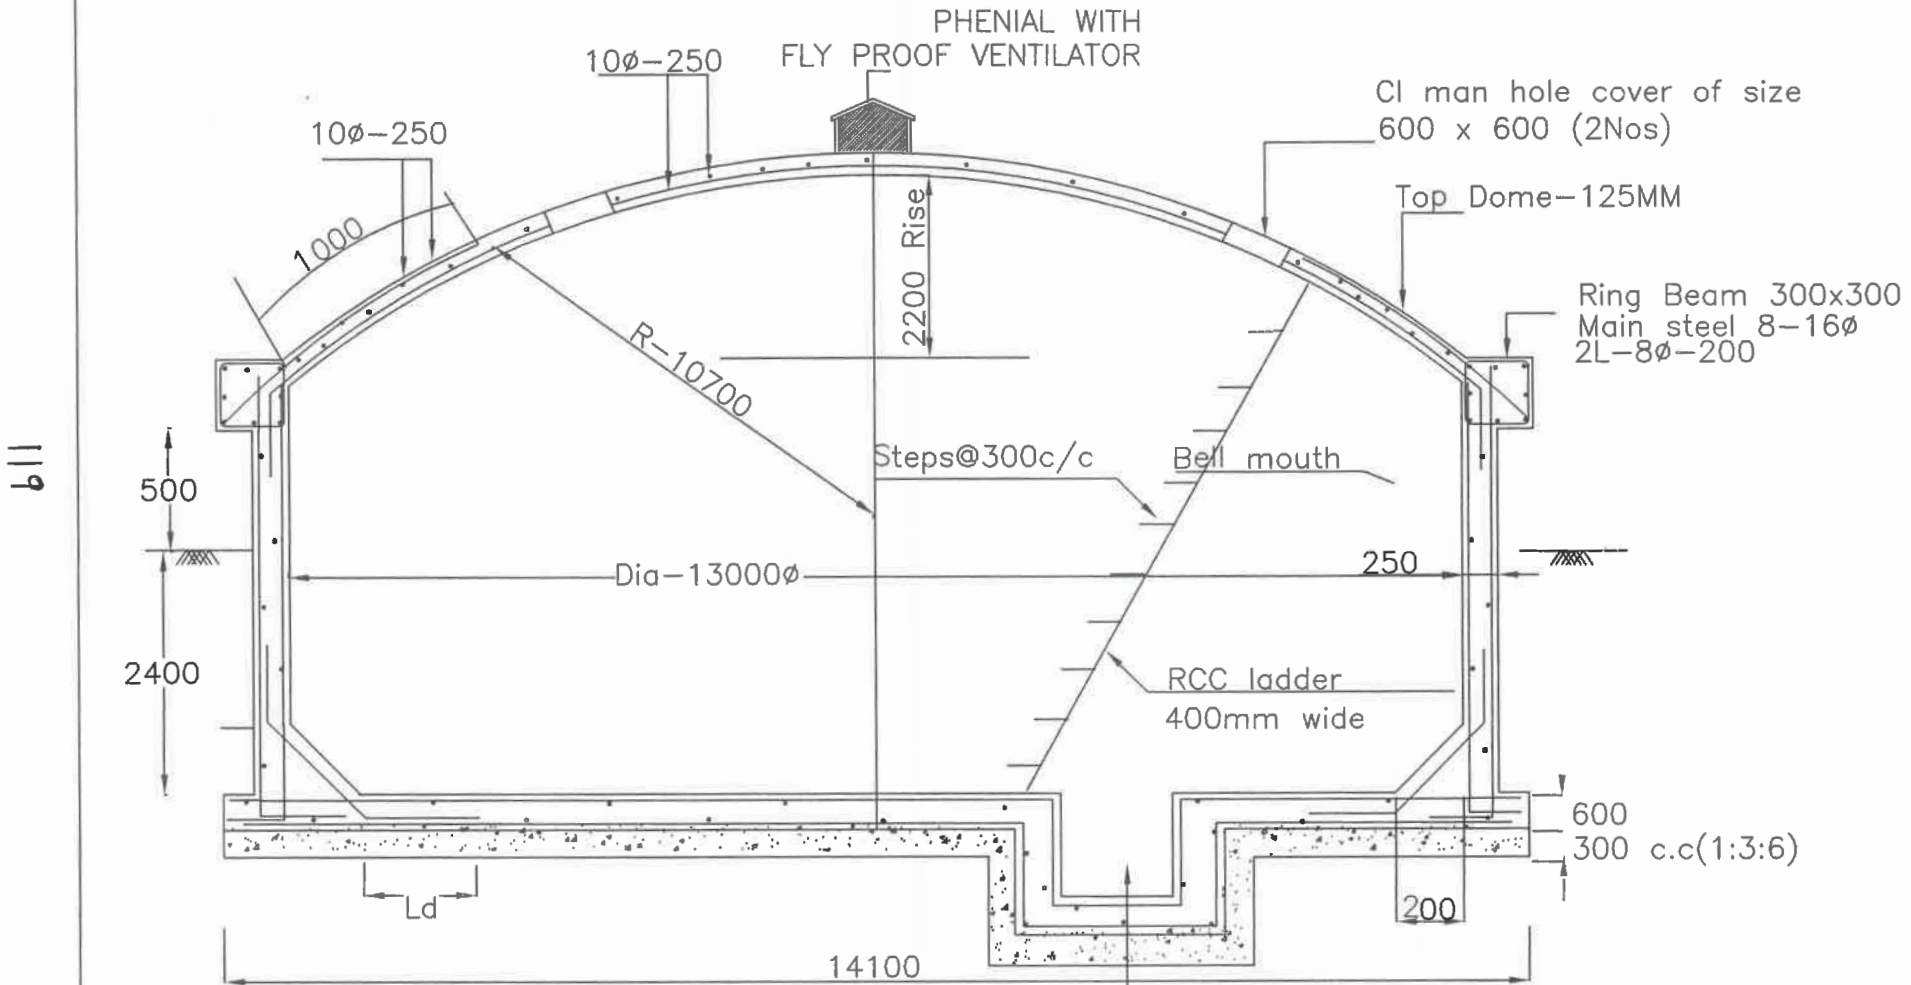

All dimensions are in 'mm'
 Concrete mix V.R.C.C M30
 Steel Fe-415
 Reinforcement Details shall be as per IS - SP34

H.P. Saigya POK
 Asst Executive Engineer Dy.Executive Engineer
Y.S.
 Executive Engineer

//Approved//
R/S
 Chief Engineer-II
 RWS&S, Gollapudi
 Vijayawada.

Sump is designed for uplift

SCHEME:
 DWG.NO.1