


90 KL SUMP

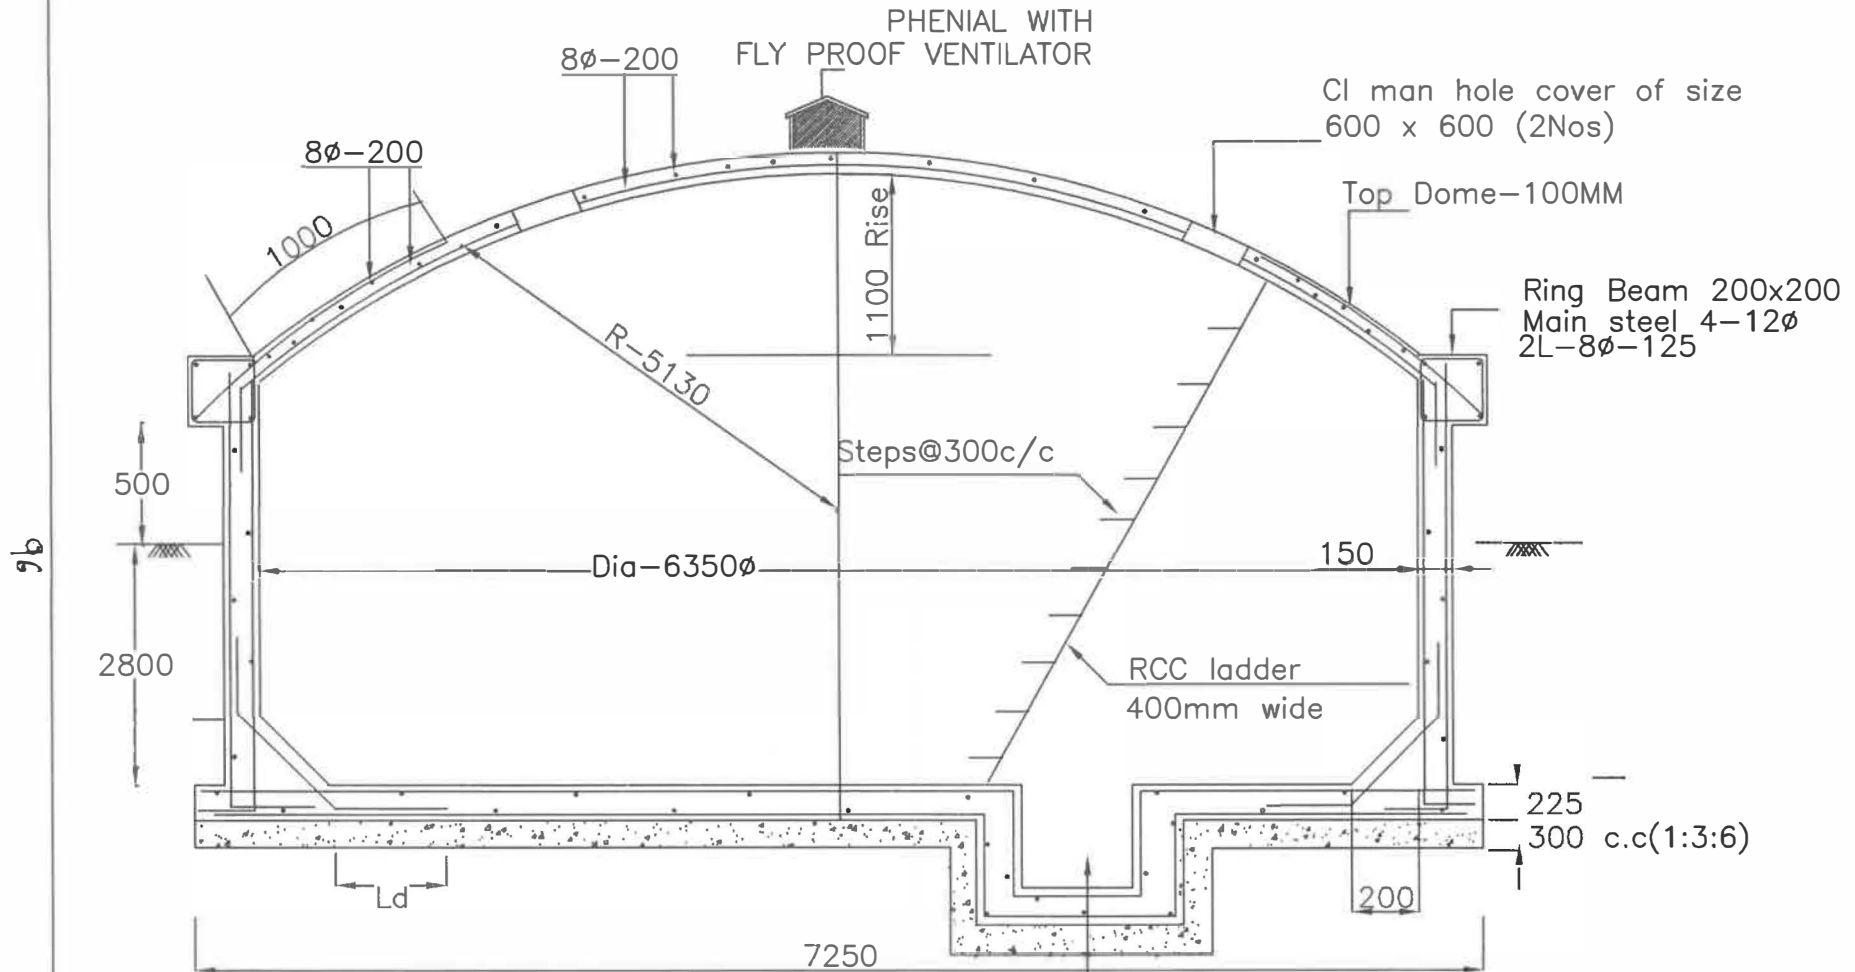

All dimensions are in 'mm'
 Concrete mix V.R.C.C M30
 Steel Fe-415
 Reinforcement Details shall be as per IS - SP34

H. P. Saitajo
 Asst Executive Engineer

Por
 Dy.Executive Engineer

YS
 Executive Engineer


P. S. Vijayawada
 Chief Engineer
 RWS&S, Gollapudi
 Vijayawada.

//Approved//

SCHEME:

DWG.NO.1

90 KL SUMP

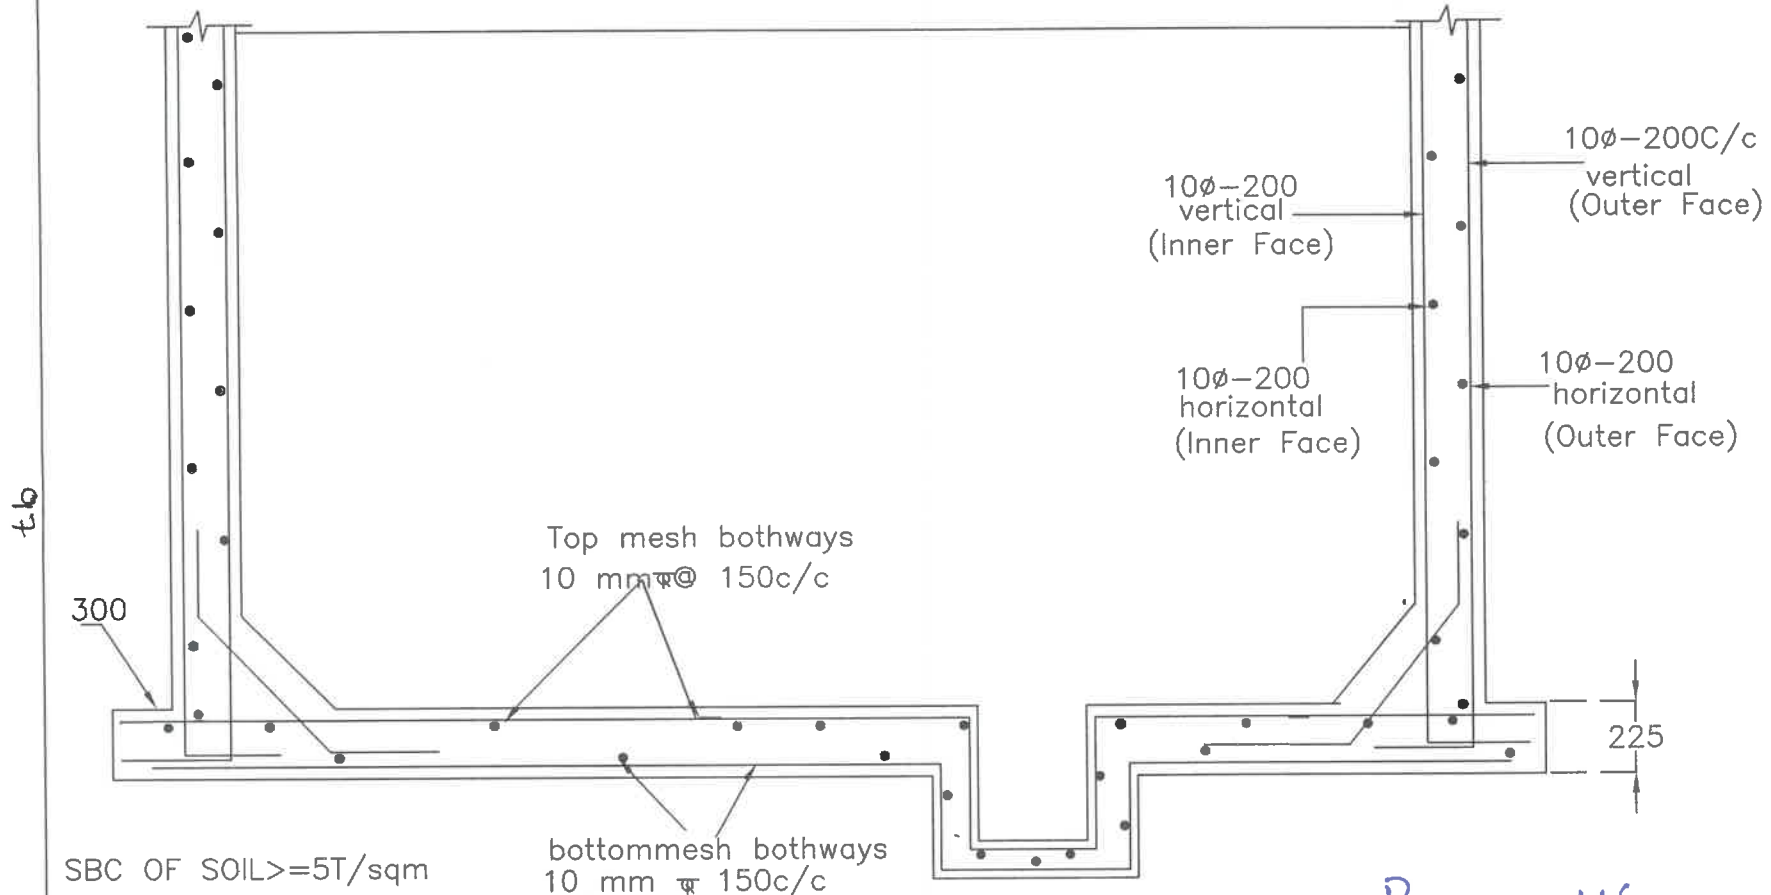


SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.75m$ below GL

H.P. Sailaja Asst Executive Engineer
PUR Dy. Executive Engineer
Y.S Executive Engineer
 //Approved//
R.S.S
 Chief Engineer
 RWS&S, Gollapudi
 Vijayawada.

SCHEME:
DWG.NO.2

90 KL SUMP

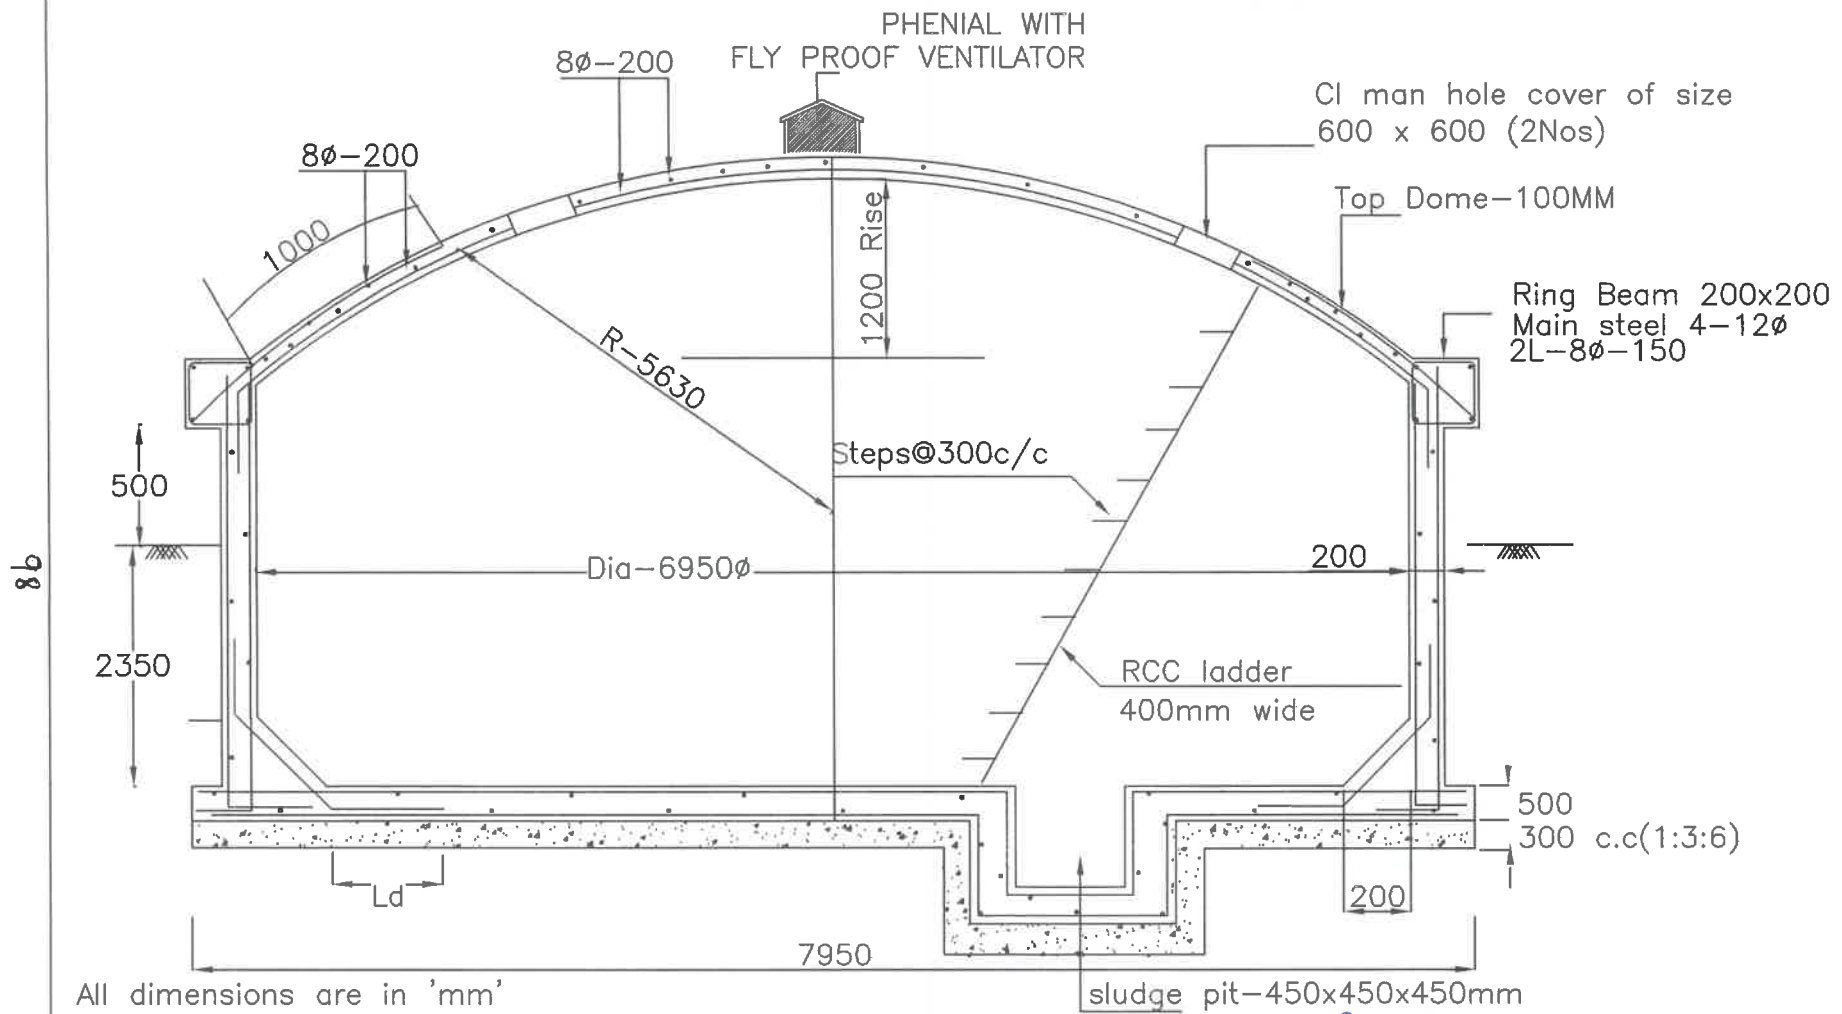

All dimensions are in 'mm'
 Concrete mix V.R.C.C M30
 Steel Fe-415
 Reinforcement Details shall be as per IS - SP34

H. L. Sailaja
 Asst Executive Engineer

POR
 Dy. Executive Engineer


Y.S
 Executive Engineer

//Approved//
R.Fish
 Chief Engineer-II
 RWS&S, Gollapudi
 Vijayawada.

Sump is designed for uplift

SCHEME:
DWG.NO.1

90 KL SUMP

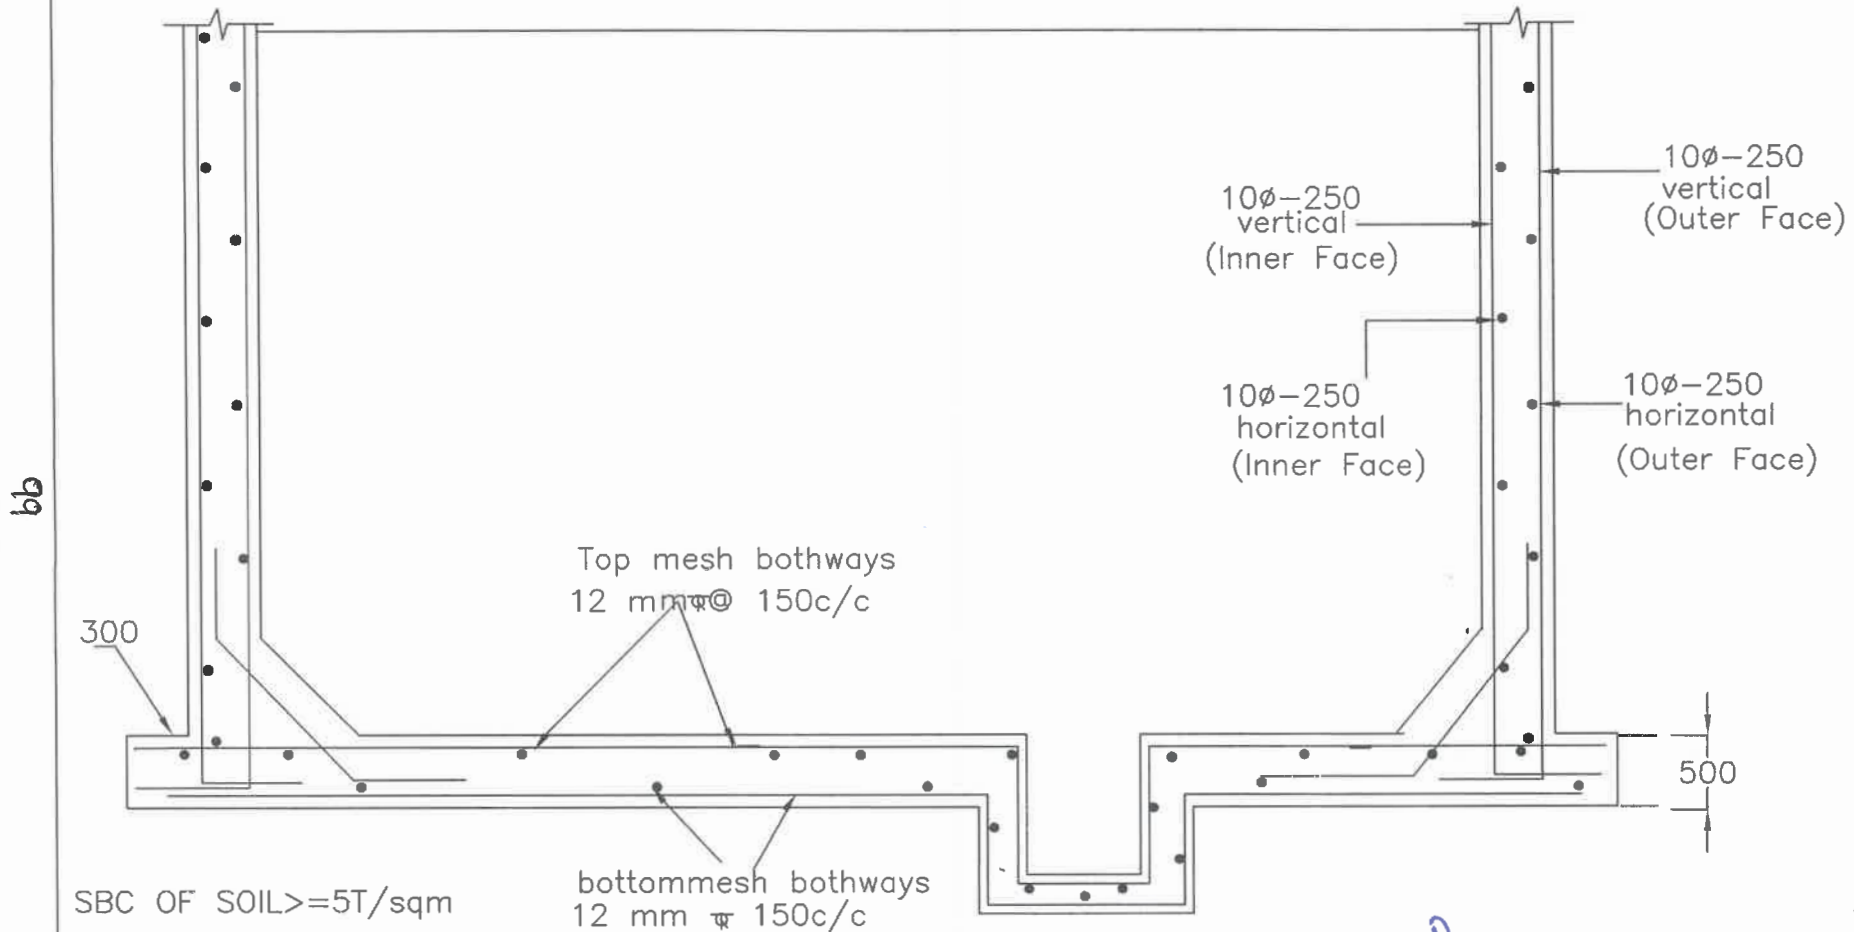

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.0m$ below GL

H.P. Sailaja Asst. Executive Engineer
 P.K. Dy. Executive Engineer
 Y.S. Executive Engineer

//Approved//
 Chief Engineer
 RWS&S, Gollapudi
 Vijayawada.

SCHEME:
DWG.NO.2